

Case Study of Envelope Sealing in Existing Multiunit Structures

Jordan Dentz, Francis Conlin,
and David Podorson
ARIES Collaborative

October 2012

NOTICE

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, subcontractors, or affiliated partners makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available electronically at <http://www.osti.gov/bridge>

Available for a processing fee to U.S. Department of Energy
and its contractors, in paper, from:

U.S. Department of Energy
Office of Scientific and Technical Information
P.O. Box 62
Oak Ridge, TN 37831-0062
phone: 865.576.8401
fax: 865.576.5728
email: <mailto:reports@adonis.osti.gov>

Available for sale to the public, in paper, from:

U.S. Department of Commerce
National Technical Information Service
5285 Port Royal Road
Springfield, VA 22161
phone: 800.553.6847
fax: 703.605.6900

email: orders@ntis.fedworld.gov

online ordering: <http://www.ntis.gov/ordering.htm>



Case Study of Envelope Sealing in Existing Multiunit Structures

Prepared for:

The National Renewable Energy Laboratory

On behalf of the U.S. Department of Energy's Building America Program

Office of Energy Efficiency and Renewable Energy

15013 Denver West Parkway

Golden, CO 80401

NREL Contract No. DE-AC36-08GO28308

Prepared by:

ARIES Collaborative

The Levy Partnership, Inc., 1776 Broadway, Suite 2205

New York, NY 10019

NREL Technical Monitor: Michael Gestwick

Prepared under Subcontract No. KNDJ-0-40347-00

October 2012

[This page left blank]

Contents

List of Figures	vi
List of Tables	vi
Definitions	i
Executive Summary	ii
1 Introduction	4
1.1 Background.....	4
1.2 Importance and Risks of Air Sealing Existing Low-Rise Multiunit Buildings	5
1.2.1 Moisture	6
1.2.2 Indoor Air Quality.....	6
1.2.3 Equipment Performance.....	7
2 Experiment	8
3 Retrofit	9
4 Results	16
4.1 Total Unit Enclosure Leakage	16
4.2 Temporary Air Sealing Tests	16
4.3 Pressure Mapping.....	17
4.4 Guarded Envelope Leakage	18
4.5 Leakage Locations	19
5 Modeled Energy Savings	21
6 Cost Effectiveness	23
7 Conclusion	25
8 References	26
Appendix A: Specifications	28
Appendix B: Air Sealing Instructions	32
Appendix C: Unguarded Envelope Testing Results	45
Appendix D: Pressure Mapping Data	47

List of Figures

Figure 1. Townhome units.....	9
Figure 2. Apartment units.....	9
Figure 3. Floor plans.....	10
Figure 4. Climate zone map used by RECS database (<i>U.S. Energy Information Administration, 2009</i>).....	11
Figure 5. Before: Disconnected duct boot behind floor register	12
Figure 6. After: Boots sealed to subfloor	12
Figure 7. Before: Openings in walls above dropped ceiling in kitchen	12
Figure 8. After: New gypsum board ceiling in kitchen isolates wall penetrations from living space.....	12
Figure 9. Before: Opening in wall above dropped ceiling	12
Figure 10. After: Sealed wall above dropped ceiling.....	12
Figure 11. Before: Poorly patched plumbing opening in wall above dropped ceiling	13
Figure 12. After: Opening in wall above dropped ceiling patched and sealed.....	13
Figure 13. Before: Gaps around window sill resulting from poor installation of windows.....	13
Figure 14. After: Window sill sealed to wall with caulk.....	13
Figure 15. Before: Old windows not closing tightly	13
Figure 16. After: New tightly closing windows	13
Figure 17. Before: Opening in wall around pipe being tested with smoke stick reveals air pathway	13
Figure 18. After: Plumbing penetrations sealed around pipes and behind escutcheons with foam and caulk	13
Figure 19. Before: Openings around water heater pipe penetrations	14
Figure 20. After: Water heater pipe penetrations sealed with foam	14
Figure 21. After: Outlet sealed to wallboard around perimeter	14
Figure 22. After: New door sweep and sill sealed to brick	14
Figure 23. After: Dryer exhaust duct sealed to wall with caulk.....	14
Figure 24. After: Gap around supply duct sealed with foam.....	14
Figure 25. After: Crack under wall in mechanical space sealed to floor with foam.....	15
Figure 26. After: Crack at bottom of door jamb sealed to floor with caulk.....	15

Unless otherwise indicated, all figures were created by ARIES.

List of Tables

Table 1. Average Total Envelope Leakage and Reduction From Retrofit.....	16
Table 2. Temporary Air Sealing Results	17
Table 3. Average of Pressure Mapping Results (Number of Locations Investigated).....	18
Table 4. Guarded Test Results	19
Table 5. Leakage to Outside and Percentage Reduction From Retrofit.....	21
Table 6. Average Modeled Savings per Unit	21
Table 7. Percentage Energy Savings	22
Table 8. Cost per Square Foot of CFA per Leakage Reduction	24
Table 9. Return on Investment.....	24

Unless otherwise indicated, all tables were created by ARIES.

Definitions

ACH ₅₀	Air changes per hour at 50 pascals
BEopt	Building Energy Optimization
BPI	Building Performance Institute
CEC	California Energy Commission
CFA	Conditioned floor area
cfm ₅₀	Cubic foot per minute of air at 50 pascals
ESF	Envelope square foot
ft ²	Square foot
IEQ	Indoor environmental quality
in ²	Square inch
GWB	Gypsum wall board
MBtu	Thousand British thermal units
NREMD	National Residential Efficiency Measures Database
RECS	Residential Energy Consumption Survey
yr	Year

Executive Summary

Sealing envelope air leakage in occupied multiunit buildings is difficult and costly to implement,¹ particularly when compared to single-family detached homes. Working around tenants complicates implementation as does the more complex nature of air pathways in multiunit buildings. In addition, because of the smaller surface to volume ratio of multiunit buildings, the cost effectiveness of air sealing is presumably lower than for single-family detached homes.

The literature, however, underscores the importance of controlling air leakage in multifamily buildings. For example, a Lawrence Berkeley National Laboratory study concluded that multiunit residential buildings and commercial buildings “seem to be about twice as leaky as single-family detached homes, per unit of building envelope area,” indicating that substantial energy savings might be associated with air sealing these types of buildings (California Energy Commission, 2006). The study also concluded that transport of pollutants between apartments and within mixed-use buildings has health consequences. Furthermore, sealing these buildings from outside air infiltration without reducing the internal transport of air could exacerbate indoor air quality problems.

There are a number of reasons to air seal a multiunit building, all of which further the goals of the Building America Program. Foremost among these is controlling heat loss and gain through the building envelope to save energy and improve comfort by eliminating drafts and temperature swings. Other important reasons include avoiding moisture problems that can result when uncontrolled air leaks introduce humid air into building cavities; minimizing air movement between apartments and other spaces (including crawlspaces and attics), which prevents contaminant transfer and improves indoor environmental quality; reducing air movement through insulation, which reduces its insulating benefit; and allowing the use of lower capacity heating and cooling equipment by reducing thermal loads.

The research questions addressed by this work include the following:

1. What reduction in leakage can be obtained and how much energy can be saved by production-scale air sealing in low-rise multiunit buildings?
2. What is the cost per unit of leakage reduction as measured by pressurization testing?
3. What are the most significant leakage sites and how much do they contribute to total leakage?

The research described in this report identified air leakage pathways in a low-rise, multiunit building type commonly found in mixed-humid climates. The report recommends corrective actions for cost-effectively remediating this leakage.

These research findings are based on the retrofit of a 236-unit, low-rise (two-story), wood frame, multiunit building complex in North Carolina (climate zone 4). A comprehensive program of air

¹ Multiunit buildings as used in the report include townhomes and low-rise (two-story) apartment buildings.

sealing was part of a more extensive retrofit effort. Pre- and post-retrofit enclosure leakage tests were conducted on 51 units and detailed diagnostics were performed on 16 units. On average, based on unguarded testing, total leakage was reduced by nearly half, from 19.7 ACH₅₀ to 9.4 ACH₅₀. Costs for air sealing were \$0.31/ft² of conditioned floor area, lower than estimates found in the literature. These lower costs are due, in part, to the relatively large scale of the project, allowing for the efficient use of labor. The lower costs also might suggest that the data contained in the National Residential Efficiency Measures Database are not an appropriate basis for estimating multiunit building costs.

Modeling of the North Carolina project using Building Energy Optimization software was conducted to project the resulting space conditioning energy cost savings. Using an average of 85% of the envelope air leakage going to the outside (based on guarded tests performed at the site), an annual return on investment of 8% to 33% was projected to result from the air sealing retrofit, suggesting that air sealing multiunit buildings can be cost effective even in relatively mild climates.

1 Introduction

Sealing envelope air leakage in existing multiunit buildings and individual apartment units is typically more difficult and costly than for single-family detached homes. For multiunit buildings, air movement between individual units, between units and the outdoors (including often dirty crawlspaces and attics), and between units and common areas, complicate the task of characterizing and sealing air leakage pathways. According to the California Energy Commission (CEC), retrofit air sealing techniques for multiunit buildings are not as well documented or developed as those for single-family construction (California Energy Commission, 2006). The ranges of construction methods (wood frame, light-gauge steel, and concrete block), styles of buildings, and construction details unique to multiunit structures contribute to greater variability in air leakage pathways.

This report identifies the most important air leakage pathways found in a two-story townhouse and apartment style development, a building type commonly found among the affordable housing stock in the mixed-humid climate. The study includes recommendations for cost-effectively identifying and correcting air leakage in these buildings.

1.1 Background

According to the *American Housing Survey for the United States: 2005*, there are approximately 25.8 million multifamily units in the United States. Eighteen million of these units are in buildings with fewer than 20 units and are most likely low-rise buildings (U.S. Census Bureau, 2006).

Limited information is currently available on air leakage in multiunit buildings. The CEC compiled and analyzed available data on indoor/outdoor air leakage rates and building leakiness parameters for commercial buildings and apartments in the United States and other developed countries. Data for only 78 multiunit residential buildings in North America were found. The proportion of high-rise buildings to low-rise buildings in the study was not reported. The CEC concluded that multiunit residential buildings and commercial buildings “seem to be about twice as leaky as single-family detached homes, per unit of building envelope area” (California Energy Commission, 2006). Although surface to volume ratio is lower for multiunit buildings, this nevertheless suggests the potential for substantial energy savings resulting from air sealing these building types. The CEC study observed little systematic variation in envelope leakage with construction type, activity type, height, size, or location. The study authors concluded that a more important issue, which needs further investigation, might be the transport of pollutants between units in apartment and mixed-use buildings, which may expose occupants to high levels of tobacco smoke or a mixture of commercial air contaminants including nail polish, dry-cleaning fumes, or other volatile organic compounds.

Several green programs and building standards have established airtightness targets.² Among these, only *LEED 2009 for Existing Buildings: Operations & Maintenance Rating System* offers

² In new residential construction (not specific to multifamily), ENERGY STAR® Version 3 requires a maximum infiltration level of 3 to 6 ACH₅₀ depending on climate (U.S. Department of Energy and U.S. Environmental Protection Agency 2011). For commercial buildings, ASHRAE 189.1 sets the upper limit of whole building leakage

guidance specifically for multifamily buildings (U.S. Green Building Council, Inc., 2008). The LEED standard requires control of environmental tobacco smoke transfer between residential units, limiting the air leakage area of each unit to 1.25 in² per 100 ft² of enclosure area (i.e., the sum of all wall, ceiling, and floor areas).

Although specific leakage locations and their severity vary greatly from building to building, the literature indicates that the following leakage areas are among the most significant in multifamily structures, and are often worthy of sealing (Brabon, undated; Hayes, 1995; Keefe, 1995; Steven Winter Associates, Inc., 2010; Oregon Department of Energy, 2008; Genge, 2009; Feustel, 1985, Lowe, 2007):

- Attic bypasses, such as through common walls, chases, dropped soffits, open core block walls, and overhangs
- Intersections of floors, walls, and ceilings, especially where structural members extend across multiple units
- Central shafts and mechanical chases/rooms between units
- Plumbing penetrations and the common wall between bathrooms of adjoining units, especially underneath bathtubs and showers, and at heating pipe penetrations
- Electrical panel, gas line, and other penetrations into the conditioned space
- Space between window/door jambs and the framing, and door latch holes through the door frame
- Cutouts in the drywall around the perimeter of fans, vents, duct shafts, air-conditioner sleeves, and medicine cabinets
- Wall and ceiling penetrations such as electrical outlets, recessed lighting, thermostats, and intercoms
- Any areas where renovations have altered the original construction.

This research documents total enclosure air leakage, estimates leakage amounts by site, and measures the improvement in airtightness and the cost of production-scale remediation in affordable, low-rise, wood frame, multiunit housing stock.

1.2 Importance and Risks of Air Sealing Existing Low-Rise Multiunit Buildings

Most older buildings were built with little attention to enclosure tightness. Air sealing alone can save 10% to 20% of single-family home energy use (U.S. Department of Energy, 2010) and is therefore an essential ingredient to the Building America goal of 30%–50% energy savings retrofits. Comparable data are not available for multiunit buildings. Reducing heat loss or gain from uncontrolled infiltration is the first necessary step in a retrofit, and a prerequisite for implementing other energy savings measures, such as adding insulation or upgrading equipment.

There are several reasons for air sealing in a multiunit building, including the following:

to 0.4 cfm/ft² of envelope area tested at 75 Pa (ASHRAE, 2009), and the U.S. Army Corps of Engineers has specified 0.25 cfm₇₅/envelope square foot (Zhivov, et al., 2010).

- To control heat loss and/or gain through the envelope to save energy
- To improve comfort by eliminating drafts and temperature swings
- To avoid moisture problems that can form when uncontrolled air leaks bring moisture into building cavities
- To reduce air movement through insulation, which reduces its insulating benefit
- To minimize air movement between apartments and other spaces (including crawlspaces and attics), preventing transfer of contaminants and improving indoor environmental quality (IEQ)
- To improve equipment performance.

All these reasons further Building America’s goals.

Energy savings from air sealing for this project is discussed later in this report. The potential effects and related risks of air sealing with respect to moisture, IEQ, and equipment performance are discussed in the following sections.

1.2.1 Moisture

Moisture problems can arise when unintended air infiltration brings moisture into building cavities. Air sealing can avert moisture problems such as the accumulation of moisture in materials that can result in material deterioration (Zhivov and Anis, 2010). Another benefit of air sealing is the potential to reduce duct loss to the outside and mitigate moisture problems in semiconditioned spaces where cooling ducts are located.

Many multiunit buildings that were not originally built with central cooling have uninsulated ducts located in floor cavities between units. These cavities can have a great deal of outside air infiltration and therefore high humidity levels much of the year. Moisture-laden air in the vicinity of the now cold ducts can result in condensation. Air sealing of the band joists and other areas that reduce air infiltration into the floor cavity reduces the risk of condensation on the ducts. Additionally, proper air sealing brings the ducts more within the conditioned space, reducing the need for remedial duct sealing in these difficult-to-access areas (Zhivov and Anis, 2010).

1.2.2 Indoor Air Quality

Envelope air sealing can minimize air movement between apartments and other spaces, preventing transfer of contaminants and maintaining better IEQ. Even though interunit air leakage might not result in significant energy loss compared to leakage to the outside, it is generally recognized that preventing interunit leakage by compartmentalizing living units is desirable from an IEQ perspective. A study in Minnesota revealed that almost 50% of renters said that secondhand smoke gets into their apartment from somewhere else in the building. Of those surveyed, more than one-quarter said that smoke bothers them “a lot” or “so much I’m thinking of moving” (Center for Energy and Environment [CEE], 2004).³

³ Note that management policy at the test site described in this report prohibits smoking within the buildings.

Most older multiunit buildings do not have a mechanical ventilation system; instead, unintended infiltration brings in outside air. Because it is uncontrolled, this results in an energy penalty. If significant infiltration reductions are achieved through an air sealing retrofit, the amount of infiltrating outside air could be inadequate for fresh air needs and a new fresh air ventilation system might be required. This could add to the cost of a retrofit. Furthermore, if pressure balances change, combustion safety (i.e., draft of flue gases) can be affected. This might require alterations to the equipment or combustion appliance zone to maintain adequate flue draft.

Improving IEQ by reducing air leakage between living units is important for occupant health and comfort (including preventing odor transmission). Its cost, however, cannot be recouped by energy savings because sealing between conditioned spaces does not save significant amounts of energy.

It is important to note, though, that reducing air infiltration from the outside without adding mechanical ventilation, reducing the transport of air between units, or both, risks exacerbating IEQ problems (California Energy Commission, 2006). When conducting air sealing retrofits, post-retrofit ventilation levels should be assessed for compliance with the relevant standards such as those of the Building Performance Institute (BPI). The BPI standard for single-family homes (Building Performance Institute, 2005) applies to buildings up to four units and to all townhome (single-family attached) units (Peters, 2012) such as those retrofit in this project. The Building Airflow Standard (based on ASHRAE ventilation standard 62-89) (AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, 1989) should be calculated to determine the minimum allowable infiltration. If post-retrofit infiltration is measured at below the allowable threshold, a fresh air ventilation system should be added, if it does not already exist. If a ventilation system exists, it should be evaluated for effective operation and improved if necessary for code compliance. In all cases, if controllable indoor pollution sources are identified, these should be mitigated at the source.

1.2.3 Equipment Performance

Space heating, cooling, and ventilation systems perform better when they are not contending with excessive air infiltration. Reducing air infiltration correspondingly reduces the quantity of particulate matter being brought into the building and the HVAC system. This will reduce the frequency of filter changes that are required and prevent particulate matter from fouling heat exchangers and other equipment. Overall, the HVAC system will perform better and require less maintenance.

Air sealing can also reduce a building's heating and/or cooling load, resulting in the need for less expensive, lower capacity equipment at the time of replacement. If equipment is not being replaced when air sealing is performed, however, the lowered leakage rate can result in oversizing of the HVAC equipment. This can reduce both the efficiency of the cooling equipment and its ability to provide adequate dehumidification.

2 Experiment

The ARIES Collaborative partnered with Ginkgo Residential, a developer and owner of affordable low-rise apartment, townhome, and other multiunit properties across the southern United States, to improve enclosure airtightness of a recently acquired apartment complex in North Carolina (climate zone 4). The air sealing work was done as part of a general rehabilitation of the approximately 40-year-old property.

Researchers hypothesized that air sealing these units could be cost effective from an energy savings standpoint. The purpose of ARIES's involvement was to answer the following questions:

1. What is the air leakage as measured by pressurization tests for these units? What reduction in leakage can be obtained through air sealing by a low-cost contractor? And how much energy can be saved through this measure as estimated through modeling?
2. What is the cost per unit of leakage reduction as measured by pressurization testing? The literature on cost effectiveness of air sealing low-rise multiunit structures is limited. This research attempts to address this gap.
3. What are the most significant leakage sites and how much do they contribute to total leakage as measured by pressurization?

To answer these questions, 51 units in low-rise multiunit buildings were tested before and after air sealing. All units were tested for total envelope leakage in cfm_{50} ; 16 units were subject to more involved testing to identify leakage sites and leakage to outdoors. Two typical units were modeled to estimate the annual energy savings resulting from air sealing. The short duration of the project did not permit collection of utility bills. The results of this research are only applicable to low-rise, wood frame, multiunit buildings. Applicability might be further limited because, although units were tested from 25 buildings of varying age ranges, they were all in the same development (although constructed at different times). Cost data might not be representative of all areas in the country or all market conditions.

In addition to answering these questions, this report also contains specifications and illustrations created to assist the air sealing contractors with their work.

3 Retrofit

The test site was in North Carolina in the mixed-humid climate (Figures 1 and 2). There are 236 apartments in 30 two-story brick and siding clad buildings constructed between 1968 and 1970. The buildings include both townhome and apartment style units, with some being built on slabs and others over crawlspaces. Figure 3 shows the floor plans. The average unit floor area is approximately 1,400 ft².



Figure 1. Townhome units



Figure 2. Apartment units

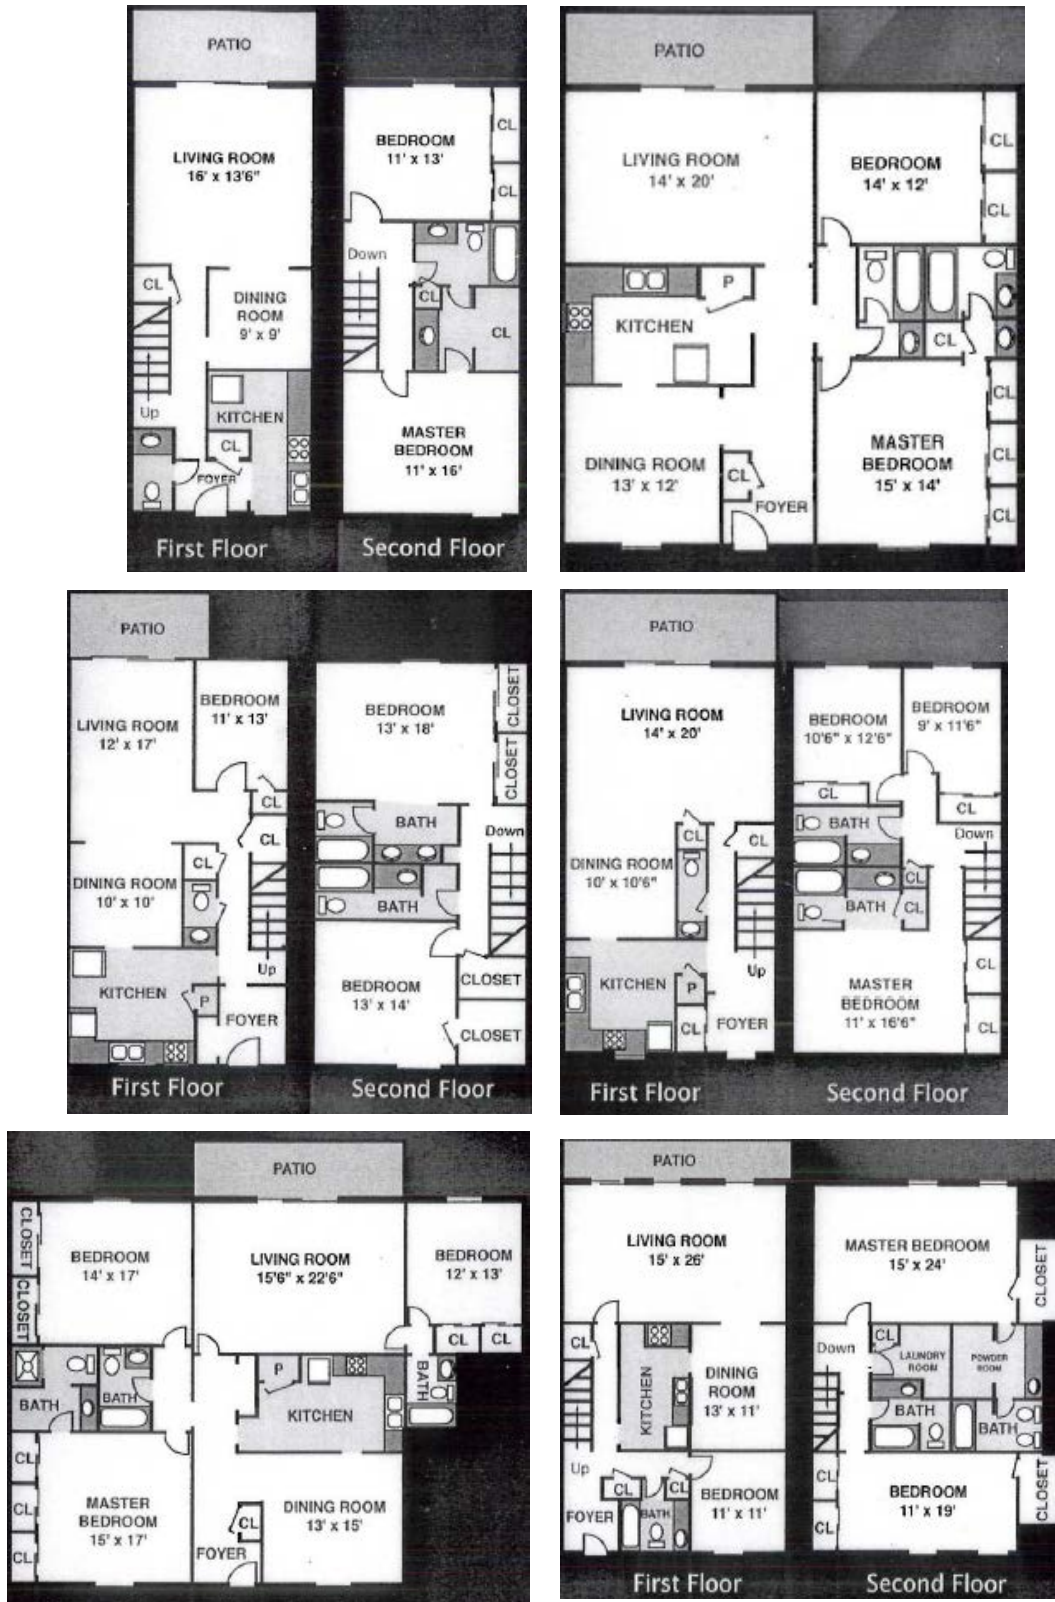
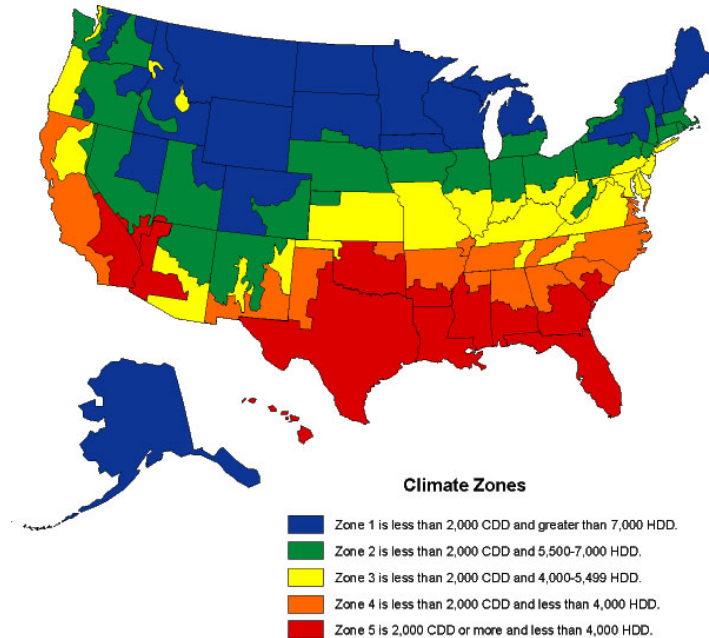


Figure 3. Floor plans

The apartments are typical of low-rise affordable multifamily housing stock throughout the Southeast and lower Midwest region. According to the Residential Energy Consumption Survey (RECS) database, there are more than nine million low-rise multifamily living units in RECS climate zones 2, 3 and 4 (Figure 4; U.S. Energy Information Administration, 2009).



**Figure 4. Climate zone map used by RECS database
(U.S. Energy Information Administration, 2009)**

Ginkgo Residential retained a contractor to perform air sealing in all units in compliance with the specification and instructions developed by ARIES (see Appendix A and B). Work progressed as units became available during occupancy changes. Work was not performed on occupied units. Units were sealed from the inside without opening walls or moving cabinets; townhome style and second-floor apartment style units were also sealed from the attic. Crews used canned spray foam and caulk. For larger openings, sheet goods such as wall board were used in combination with caulk and foam. Ginkgo’s goal was to reduce leakage by approximately 50%, a level of airtightness that would not require the addition of new fresh air ventilation. Blower-door guided air sealing was employed. A blower door was set up and running during air sealing to assist crews in identifying leaks and to measure the ongoing reduction in air leakage.

The following photographs (Figure 5 through Figure 26) illustrate common leakage sites that were found and sealed during the work.



Figure 5. Before: Disconnected duct boot behind floor register



Figure 6. After: Boots sealed to subfloor



Figure 7. Before: Openings in walls above dropped ceiling in kitchen



Figure 8. After: New gypsum board ceiling in kitchen isolates wall penetrations from living space



Figure 9. Before: Opening in wall above dropped ceiling



Figure 10. After: Sealed wall above dropped ceiling



Figure 11. Before: Poorly patched plumbing opening in wall above dropped ceiling



Figure 12. After: Opening in wall above dropped ceiling patched and sealed



Figure 13. Before: Gaps around window sill resulting from poor installation of windows



Figure 14. After: Window sill sealed to wall with caulk



Figure 15. Before: Old windows not closing tightly



Figure 16. After: New tightly closing windows



Figure 17. Before: Opening in wall around pipe being tested with smoke stick reveals air pathway



Figure 18. After: Plumbing penetrations sealed around pipes and behind escutcheons with foam and caulk



Figure 19. Before: Openings around water heater pipe penetrations



Figure 20. After: Water heater pipe penetrations sealed with foam



Figure 21. After: Outlet sealed to wallboard around perimeter



Figure 22. After: New door sweep and sill sealed to brick



Figure 23. After: Dryer exhaust duct sealed to wall with caulk



Figure 24. After: Gap around supply duct sealed with foam



Figure 25. After: Crack under wall in mechanical space sealed to floor with foam



Figure 26. After: Crack at bottom of door jamb sealed to floor with caulk

4 Results

The following four types of testing were conducted to evaluate the condition of the existing units and effects of the air sealing retrofit:

1. Total unit enclosure leakage
2. Temporary air sealing tests
3. Pressure mapping
4. Guarded envelope leakage.

A description, the purpose, and the results of each test type follow.

4.1 Total Unit Enclosure Leakage

Total enclosure leakage was measured for all units as they were retrofitted. Table 1 shows overall average post-air sealing leakage reduction. The complete test results for 51 living units are included in Appendix C: Unguarded Envelope Testing Results

Table 1. Average Total Envelope Leakage and Reduction From Retrofit

Unit	Pre-Retrofit Average	Average Reduction	Average % Leakage Reduction ^a
cfm/Conditioned Floor Area (CFA)	2.6	1.4	-50%
ACH ₅₀	19.8	10.4	-50%

^a Average improvement of each of the 51 cases. Note that this differs from the average reduction divided by the pre-retrofit average.

4.2 Temporary Air Sealing Tests

One goal of the project was to determine which leakage locations contributed the most to total unit air leakage. During blower door testing, leakage sites were successively sealed using tape and the resulting change in air leakage was recorded. Table 2 gives the results. Consistent sources of envelope leakage included duct leaks, penetrations in kitchens (primarily soffits and dropped ceilings), and windows (windows had recently been replaced but were improperly sealed between the frame and rough opening).

Table 2. Temporary Air Sealing Results

Building	Unit	CFA (ft ²)	Base Leakage (ACH)	Base Leakage (cfm)	Reduction in Leakage (% of Base)								
					Ducts	Kitchen	Bath	Windows	Outlets	Plumbing	Other	Total	
2030	8	1,500	52.7	10536		76 ^a	7	0.2	0.4				84
2030	10	2,200	9.5	2798	20 ^b	3				3	1 ^c		27
2117	16	1,700	15.5	3515	19	32		3	6				60
2117	2	1,200	10.5	1674	17			14	3	1	2 ^d		37
2117	3	1,200	12.7	2039	12			10	10	0.2	5 ^e		37
2309	16	1,500	27.5	5492	1 ^f	0.5 ^g	65 ^h	5					72
2330	7	2,000	15.8	4201	8	33 ^a		11	3				55
Average (%)					13	29	36	7	4	1	3		53

^a The large leakage reduction in 2030 unit 8 and 2330 unit 7 when the kitchen was sealed off was caused by the fact that the space above the dropped ceiling in the kitchen was completely open to the wall cavity.

^b Including mechanical closet

^c Electrical penetrations

^d Access panel

^e Hatch to plumbing

^f Return only

^g Penetrations only

^h The large leakage reduction in the bathroom of 2309 unit 16 results from large voids in the bathroom wall.

4.3 Pressure Mapping

During pressurization testing of four units, the pressure with reference to outdoors was measured in selected building cavities to assess the degree to which those cavities were connected to the outside via air pathways. Table 3 gives the results of this pressure mapping. The Average Ratio Connected to Outside column indicates the degree to which the location is outside of the pressure boundary of the unit. A ratio of 100% indicates that the location is completely outside the pressure boundary, and a ratio of 0% indicates that it is completely inside. For example, if a wall cavity measures -20 Pa with respect to outside while the unit is being depressurized to -50 Pa with respect to outside, that wall cavity would be considered 60% connected to outside $((-20) - (-50)) / (-50) = 0.60$). Appendix D contains the complete pressure mapping data.

Pressure mapping was used to characterize leakage pathways. It also indicated that much of the leakage from the units was to the outside, which was consistent with the guarded testing results described next. Most interstitial spaces (common walls and ceilings) were far more connected to outside the apartments than to inside. This also has important implications for duct leakage when the ducts are in these spaces. Leakage from these ducts will be mostly to the outside.

Table 3. Average of Pressure Mapping Results (Number of Locations Investigated)

	Location (number of cases)	Average Ratio Connected to Outside (%)
Intended Interior Space	Interior living area	0
	Common wall cavity (6)	75
	Exterior wall cavity (6)	61
	Interior wall cavity (2)	52
	Ceiling cavity between floors (1)	70
	Kitchen chase (1)	55
	Kitchen soffit (1)	88
	Ducts (4)	69
Intended Exterior Space	Dropped ceilings (3)	73
	Crawlspace (1)	55
	Attic (4)	73

4.4 Guarded Envelope Leakage

Table 4 summarizes the results of guarded testing of six units. A guarded test is conducted by depressurizing (or pressurizing) adjacent living units to the same pressure, thereby eliminating any driving force and leakage between the two (or more) adjacent units. Guarded tests can be used to determine the portion of air leakage that goes to conditioned versus unconditioned spaces.

Because the dwellings were occupied, guarded testing was only conducted where access to neighboring units was available. In all but one case, only one unit neighboring the subject unit was accessible. As a result, the tests were partially guarded, meaning that leakage between units was cancelled out on only one side. The total leakage to outside was estimated by multiplying the leakage reduction achieved by guarding (as compared to an unguarded test) by the ratio of the total wall area to the guarded wall area.

For example, in a townhome unit with 1,200-ft² wall area that was guarded to one side comprising 400 ft² of wall area, the leakage reduction would be multiplied by 1,200/400, or 3. If the unguarded test resulted in 2,000 cfm₅₀ leakage and the guarded test resulted in 1,900 cfm₅₀ leakage, the 100 cfm₅₀ reduction would be multiplied by three and then deducted from the unguarded test result, yielding an estimated 1,700 cfm₅₀ leakage to the outside. Note that this method only yields a gross estimate and does not consider differences in wall construction. It is used here only to obtain a general idea of the level of leakage to outside and for modeling inputs.

The low leakage reductions seen in the guarded tests are consistent with the pressure mapping results, which suggested that building cavities are well connected to outdoors. Taken together they suggest that, at least under test conditions, air infiltrating through common walls and ceilings is more likely being drawn from the outside than from an adjacent unit. The average leakage to outside of the six guarded tests was 85% of total leakage when adjusted as described previously.

Table 4. Guarded Test Results

Building	Unit	Pre- or Post-Test	Adiabatic sides	Guarded sides	Type	Unguarded Leakage (cfm ₅₀)	Guarded Leakage (cfm ₅₀)	Leakage Reduction (cfm ₅₀)	Guarded Area (ft ²)	Total Leakage Area to Inside (ft ²)	Total Leakage Area to Outside (ft ²)	Interpolated total leakage to conditioned space (cfm ₅₀)	Estimated leakage to outside as percentage of unguarded
1800	15	Pre	2	1	Twn	2,412	2,339	73	675	1,710	1,860	185	92
2030	6	Pre	3	1	Apt	2,685	2,528	157	356	2,211	2,184	976	64
2132	23	Pre	1	1	Twn	2,302	2,224	78	774	1,800	1,452	181	92
1800	12	Post	2	2	Twn	1,782	1,720	62	1350	1,710	1,860	79	96
1800	17	Post	1	1	Twn	1,394	1,091	303	675	1,035	1,785	465	67
2030	6	Post	3	1	Apt	1,546	1,546	0	356	2,211	2,184	0	100
Average						2,020	1,908	112	698	1,780	1,888	314	85

4.5 Leakage Locations

Based on inspections and the testing, the major areas of envelope leakage were found to be (in approximate sequence from most to least significant): plumbing and electrical penetrations, soffits/dropped ceilings, ducts, windows, and floor–wall intersections.

- Plumbing and electrical penetrations.** Original plumbing, electrical and appliance installation, and subsequent repair work were completed without an air sealing protocol in effect. Little attention was paid to sealing gaps between plumbing and electrical penetrations and the air barrier material. At some locations, sections of the air barrier material—interior gypsum wallboard (GWB) in this case—were completely removed to allow repair access and were not replaced after the repairs were completed. Unsealed penetrations of this type were most commonly found in HVAC closets, above dropped ceilings, under/inside cabinets, and behind appliances, but were also present in the living space.
- Soffits/dropped ceilings.** Dropped ceilings were found to conceal a variety of air barrier deficiencies. The air barrier material above the dropped ceiling was not air sealed at material intersections, permitting air leakage between the living space and the vented attic. Plumbing and electrical penetrations hidden by the dropped ceiling were not air

sealed. Often, large sections of the air barrier material were removed to permit repair access and were not replaced or sealed after repairs were completed. For the dropped ceiling condition in top-floor locations, the missing sections of air barrier material resulted in direct (visible) connectedness to the vented attic and strong connection to the outdoors. Blower door testing while temporarily sealing the kitchen from the rest of the apartment with adhesive films illustrated profound air leakage into these areas.

- **Ductwork.** Duct leakage to the outside was substantial because of improper installation, deterioration over time, or other causes.⁴ According to property management, leakage was great enough to significantly increase utility bills and decrease occupant comfort. Missing or deteriorated duct boots resulted in exchange of air between the living area and the crawlspaces and attic where air quality is relatively poor. Duct leakage within wall cavities sometimes resulted in moisture signatures inside the living space where cool, uninsulated ducts and contact with outside air resulted in condensation and water staining. Accessible ducts were replaced before the air sealing retrofit. Information on mitigating duct leakage can be found in *Measure Guideline: Sealing and Insulating Ducts in Existing Homes* (Aldrich & Puttagunta, 2011).
- **Windows.** The original windows had reached the end of their serviceable life. Closing/sliding/locking mechanisms, weather stripping, and the panes themselves had broken or deteriorated over time to such an extent that gaps of 1 in. or greater were common. The deteriorated state of the windows increased heating/cooling costs, negatively affected occupant comfort, allowed pest infiltration, and posed a potential security problem. Windows were replaced shortly before air sealing work began.
- **Floor-to-wall intersections.** During original construction, bottom plates were not sealed or gasketed to subflooring, resulting in greater than expected air leakage into wall cavities at the floor-to-wall intersections. GWB interior walls generally do not completely reach the subflooring material. The gap created by the installation of the GWB, combined with the lack of bottom plate sealing, resulted in voids that permitted air leakage into the unconditioned space of the wall cavities.

⁴ Duct testing by ARIES confirmed high levels of leakage.

5 Modeled Energy Savings

To quantify the energy cost savings resulting from the air sealing, pre- and post-retrofit conditions were modeled using Building Energy Optimization (BEopt) software. Separate models were created for a typical apartment and a typical townhome unit. The models project the energy and cost savings for three climate locations using the average pre- and post-retrofit air leakage results found in the field. Locations in the mixed-humid and the cold climate were selected because of the prevalence of these building types in those climates.

Two adjustments were made to the BEopt models to simulate dwellings in multiunit buildings. First, demising walls, floors, and ceilings were modeled as windowless and with an R-value of 100 to replicate the adiabatic condition. Because walls cannot be modeled individually, the total UA value of the dwelling was calculated using R-100 for the demising walls and common ceilings/floors, and the actual insulation level for the outer walls.⁵ This value was then averaged per square foot of wall area for entry into BEopt. Secondly, air infiltration levels were multiplied by the 85% leakage to outside ratio calculated from the guarded tests to account only for the leakage to the outside. (Air leakage between conditioned spaces does not affect total energy consumption of the building). Table 5 shows the air leakage values used for modeling. Although the apartments have newly installed heat pumps (heating seasonal performance factor 8.6, seasonal energy efficiency ratio 14), the savings are shown for both heat pumps and electric furnaces with central air conditioning (seasonal energy efficiency ratio 14).

Table 5. Leakage to Outside and Percentage Reduction From Retrofit

Unit	Pre-Retrofit Average	Average Reduction	Average % Leakage Reduction
cfm/CFA	2.2	1.2	50
ACH ₅₀	16.7	8.7	50

Table 6 presents the modeled savings of the air sealing retrofits using the reductions in leakage from Table 5. Table 7 presents the savings in modeled total home energy consumption in percentage terms.

Table 6. Average Modeled Savings per Unit

Location	Townhome				Apartment			
	Heat Pump		Electric Furnace		Heat Pump		Electric Furnace	
	MBtu/yr	\$/yr	MBtu/yr	\$/yr	MBtu/yr	\$/yr	MBtu/yr	\$/yr
Durham, NC	7.9	60.53	20.2	154.70	5.0	38.67	10.0	76.56
Cincinnati, OH	14.6	116.77	31.0	247.95	10.2	81.52	16.6	132.74
Indianapolis, IN	28.9	203.63	48.6	342.87	21.2	149.77	30.9	218.14

⁵ This method was recommended by BEopt developers at the National Renewable Energy Laboratory..

Table 7. Percentage Energy Savings

Location	Townhome				Apartment			
	Heat Pump		Electric Furnace		Heat Pump		Electric Furnace	
	% total	% space conditioning	% total	% space conditioning	% total	% space conditioning	% total	% space conditioning.
Durham, NC	5	17	9	21	3	15	5	16
Cincinnati, OH	7	19	11	21	6	19	7	18
Indianapolis, IN	12	25	15	25	10	25	12	23

6 Cost Effectiveness

Enclosure air sealing activities can be judged on cost effectiveness based on space conditioning energy saved; however, this does not factor in two other major air sealing benefits—moisture control and IEQ. A literature search for cost effectiveness of air sealing in multiunit buildings revealed limited results. Studies of retrofits in other building types, though, indicate that air sealing can often be cost effective in older buildings. The following sources provide cost estimates for air sealing and are summarized in Table 8.

The National Residential Efficiency Measures Database (NREMD) is a publicly available, centralized resource of residential building retrofit measures and costs for the U.S. building industry.⁶ The database is intended to help users determine the most cost-effective retrofit measures for improving energy efficiency of existing homes. It is accessible to software programs that evaluate the cost effectiveness of retrofit measures to improve the energy efficiency of residential buildings, as well as to home performance contractors and manufacturers of residential materials and equipment. NREMD contains cost data for residential air sealing retrofits estimated in dollars per square foot of CFA at a range of specified leakage reduction levels (U.S. Department of Energy and National Renewable Energy Laboratory, 2011). Leakage is assumed to be to the outside because of the presumed single-family detached focus of the database. BEopt uses building envelope leakage reduction estimates and costs derived from the NREMD (National Renewable Energy Laboratory, 2011).

CEE conducted research on tobacco smoke transfer in six multifamily buildings in Minnesota in an effort to quantify air sealing measures to reduce contaminant transfer between units. Five of the buildings were 4 stories or shorter; one was 11 stories. The results showed a post-retrofit median leakage reduction of 139 cfm₅₀—or 18% of the total air leakage of the unit—at an average cost of \$0.046/ft² of CFA per 1% reduction in air leakage (CEE, 2004). This is on the high end of the NREMD estimates. Because this effort was focused on controlling air transfer between units (i.e., total leakage), it cannot be judged solely by energy costs saved.

Table 8 compares the cost estimates from the cited literature to the results of the retrofit, based on the air sealing contract amount and the total floor area of the retrofit project. The actual costs incurred were significantly lower than those cited by the sources mentioned. Based on an average of 1,400-ft² floor area, typical per-apartment costs for air sealing alone were \$441.

Reasons for the lower costs might include the production nature of the work (large volume, repetitive); the competitive bid process used by the owner; the rough condition of the units at the time of retrofit (yielding “lower hanging fruit”); and the slow construction market conditions during the project. Note that the air sealing contractor was also retained to conduct other work including insulation, which might have helped the owner obtain a lower price than if the contract was for air sealing alone. In addition, the work was conducted on vacant units as part of a large rehabilitation of the property. Air sealing occupied units as a stand-alone measure would likely cost more.

⁶ Although not explicitly stated in public documentation, it is presumed that the NREMD data are derived from single-family home measures.

Table 8. Cost per Square Foot of CFA per Leakage Reduction

Source	Leakage Reduction Total (%)	Leakage Reduction to Outside (%)	Cost in \$/CFA
NREMD	25	25	0.23–0.6
	40	40	0.4–2.2
	50	50	0.51–3.80
	60	60	1.1–4.7
CEE	18	–	0.828
BEopt	22	22	0.36
	29	29	0.63
	45	45	1.61
	49	49	2.30
	60	60	2.90
Test Site Average	50%	50% (estimated)	0.31

A study of nonresidential buildings in northern climates indicated that a 40% to 70% reduction in infiltration commonly yields a 15% to 25% reduction in heating costs, or a 9% to 15% reduction in overall energy expenditure, with a payback period of less than 2 years (Kokko, 2010). Modeling of the estimated 50% leakage to outside reduction at the test site yields a 15% to 25% reduction in space conditioning costs, or a 3% to 15% reduction in overall energy expenditure, with a payback period of 1.4–12.2 years, depending on climate location. Table 9 shows the return on investment based on the modeled savings. These savings and returns are for envelope air sealing alone and do not include savings resulting from other measures implemented at the test site.

Table 9. Return on Investment

Location	Townhome		Apartment	
	Heat Pump (%)	Electric Furnace (%)	Heat Pump (%)	Electric Furnace (%)
Durham, NC	13	33	8	16
Cincinnati, OH	25	53	17	28
Indianapolis, IN	43	73	32	46

7 Conclusion

The approximately 40-year old low-rise multiunit affordable rental buildings studied in this project were found to have very leaky enclosures. The vast majority of the leakage was to the outside. Major leakage locations found were plumbing and electrical penetrations, dropped ceilings/soffits, windows, and floor-to-wall intersections. Previous repair locations were also a major source of leakage. Air sealing costs per unit of air leakage reduction were lower than typically cited in the literature, possibly because of the repetitive, production-scale nature of the project as compared to smaller, on-off jobs. Reductions in air leakage of greater than 50% were consistently obtained without highly invasive measures, in part because of the poor existing conditions.

The low air sealing costs contributed to an attractive return on investment in the North Carolina climate and would be even more attractive in colder climates based on the results of modeling in BEopt.

Specific recommendations for others embarking on similar projects include the following:

- When contracting for air sealing work it is important to establish requirements with a set of written specifications that align with leakage reduction goals. Detailed guidelines including graphics can also improve results by setting expectations.
- During the project an owner's representative should inspect air sealing contractor work to ensure neat and clean installation.
- Testing is important to ensure that leakage reduction goals are met. Ginkgo insisted on 100% testing by the contractor. If a third party is used, a random sampling approach could also be effective.
- Doing air sealing in conjunction with other retrofit work can reduce costs. Work should be sequenced, however, to reduce the likelihood that following contractors will undo air sealing measures by disturbing foam seals or other repairs to perform their own work.
- Duct leakage is also an important contributor to enclosure leakage, but is not typically addressed by air sealing work. Depending on duct materials and accessibility, it might be cost effective to repair ducts during accession of the attics for ceiling air sealing.
- Finally, when general repairs/upgrades are made to a building, contracts should include specifications for restoring the air barrier. Inspections should verify these, particularly in concealed locations such as air handler enclosures and behind dropped ceilings.

8 References

- American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (2009). *Standard 189.1 | Standard for the Design of High-Performance, Green Buildings*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.
- Aldrich, R., & Puttagunta, S. (2011). *Measure Guideline: Sealing and Insulating Ducts in Existing Homes*. Oak Ridge: U.S. Department of Energy.
- AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS. (1989). *ASHRAE 62-1989 ASHRAE STANDARD VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY*. Atlanta: AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.
- Anis, W. (2005, March). Commissioning the Air Barrier System. *ASHRAE Journal*.
- Bouhamra, W. S., Elkilani, A. S., & Abdul-Raheem, M. Y. (1998, August). Predicted and Measured Air Exchange Rates. *ASHRAE Journal*.
- Brabon, E. (n.d.). *Air Sealing Mixed Use & Multifamily Buildings: Exterior Shell & Unit-to-Unit Compartmentalization*. (S. W. Associates, Ed.) Retrieved April 06, 2011, from Efficiency Vermont:
http://www.encyvermont.com/docs/for_partners/bbd_presentations/bbd_2011/Thursday%20Presentations/Thursday%20Presentations/145pm/BBD11_Brabon_AirSealing.pps
- Building Performance Institute. (2005, February 28). Technical Standards for the Building Analyst Professional. Malta, NY, USA: Building Performance Institute.
- California Energy Commission. (2006). *INDOOR-OUTDOOR AIR LEAKAGE OF APARTMENTS AND COMMERCIAL BUILDINGS*. Berkeley, CA: California Energy Commission; Public Interest Energy Research (PIER) Program.
- Center for Energy and Environment. (2004). *Reduction of Environmental Tobacco Smoke Transfer in Minnesota Multifamily Buildings Using Air Sealing and Ventilation Treatments*. Minneapolis, MN: Center for Energy and Environment.
- FEUSTEL, H. E., & LENZ, T. P. (1985). Patterns of Infiltration in Multi-family Buildings. *Building and Environment*, 7-13.
- Genge, C. (2009, April). Controlling Air Leakage In Tall Buildings. *ASHRAE Journal*.
- Hayes, V. (1995, October). *Air Sealing in Low-Rise Buildings*. Retrieved April 07, 2011, from Home Energy Magazine Online:
<http://www.homeenergy.org/archive/hem.dis.anl.gov/eehem/95/950910.html>
- Keefe, D. (1995, December). *Air Sealing in Occupied Homes*. Retrieved April 07, 2011, from Home Energy Magazine Online:
<http://www.homeenergy.org/archive/hem.dis.anl.gov/eehem/95/951111.html>
- Kokko, J. (2010, February 10). *Retrofitting Northern Buildings for Maximum Savings*. Retrieved April 08, 2011, from Energy - Energy, Mines, and Resources - Government of Yukon:
http://www.energy.gov.yk.ca/pdf/john_kokko_retrofitting_for_energy_efficiency.pdf
- Lowe, R., & Wingfield, J. (2007). Evidence for heat losses via party wall cavities in masonry construction. *Building Services Engineering Research & Technology*, 161-181.
- National Renewable Energy Laboratory. (2011, December 13). *Home | BEopt*. Retrieved December 13, 2011, from National Renewable Energy Laboratory: <http://beopt.nrel.gov/>
- New York State Energy Research and Development Authority. (2010). *Minimum Performance Standards For Special Projects participating in Home Performance with ENERGY STAR*

- (HPwES) And New York ENERGY STAR Homes Programs (NYESH). New York State Energy Research and Development Authority.
- Oregon Department of Energy. (2008). *Reducing Heat Loss Due to Air Leakage*. Oregon Department of Energy.
- Peters, T. (2012, February 24). Private correspondence. (J. Dentz, Interviewer)
- Steven Winter Associates, Inc. (2010). *AIR SEALING GUIDE; MULTIFAMILY CONSTRUCTION*. Steven Winter Associates, Inc.
- The Dow Chemical Company. (2010, July 01). *Case Study to Measure the Impact of Air Sealing*. Retrieved April 12, 2011, from FamilyFeatures.com:
http://www.familyfeatures.com/releases/dowfiles/179-15016_Weatherization_Case_Study.pdf
- U.S. Census Bureau. (2006). *American Housing Survey for the United States: 2005*. Washington D.C.: U.S. Government Printing Office.
- U.S. Department of Energy | U.S. Environmental Protection Agency. (2011, April 01). *ENERGY STAR Qualified Homes, Version 3 (Rev. 03)*. Retrieved April 21, 2011, from ENERGY STAR:
http://www.energystar.gov/ia/partners/bldrs_lenders_raters/downloads/NationalProgramRequirements_v3.pdf
- U.S. Department of Energy. (2010). *Building America Best Practice Series: Air Sealing; A Guide for Contractors to Share with Homeowners*. U.S. Department of Energy.
- U.S. Energy Information Administration. (2009). *RECS Survey Data Tables*. Retrieved May 24, 2011, from U.S. Energy Information Administration - EIA:
<http://www.eia.gov/consumption/residential/data/2009/excel/HC2.1%20Structural%20and%20Geographic%20by%20Housing%20Unit%20Type.xls>
- U.S. Green Building Council, Inc. (2008). *LEED 2009 for Existing Buildings: Operations & Maintenance Rating System*. Washington DC: U.S. Green Building Council, Inc.
- US Department of Energy | National Renewable Energy Laboratory. (2011, April 12). *NREL: National Residential Efficiency Measures Database - Retrofit Measures for Air Sealing*. Retrieved April 12, 2011, from National Renewable Energy Laboratory (NREL) Home Page:: <http://www.nrel.gov/ap/retrofits/measures.cfm?gId=1&ctId=1>
- Zhivov, A., & Anis, W. (2010). BUILDING AIR TIGHTNESS AND AIR BARRIER CONTINUITY REQUIREMENTS. *Energy and Water Conservation Design Requirements for Sustainment, Restoration and Modernization (SRM) Projects | US Army Corps of Engineers*.
- Zhivov, A., Bailey, D., Herron, D., Dittus, D., Erickson, B., Brennan, T., et al. (2010). *U.S. ARMY CORPS OF ENGINEERS AIR LEAKAGE TEST PROTOCOL FOR MEASURING AIR LEAKAGE IN BUILDINGS*. U.S. ARMY CORPS OF ENGINEERS.

Appendix A: Specifications

GENERAL

1.1 SUMMARY

A. This specification includes the following:

1. Air sealing techniques, priorities and products specific to the air sealing project.
- B. Related Sections
 1. NOT USED

1.2 DEFINITIONS

A. Air Barrier: An element or assembly which controls air movement into and out of a structure

1.3 PERFORMANCE REQUIREMENTS

A. Air Sealing Assemblies shall be capable of accommodating substrate movement, joints and intersections, construction material, and other transitions without deterioration or air leakage exceeding specified limits.

1.4 ACTION SUBMITTALS

- A. Product Data: Include manufacturer's written instructions for evaluating, preparing, and treating substrate, technical data, and tested physical and performance properties of air barrier.
- B. Shop Drawings: Include details for substrate joints and cracks, penetrations, voids, and attic assemblies.

1.5 INFORMATIONAL SUBMITTALS

A. NOT USED

1.6 QUALITY ASSURANCE

- A. Applicator Qualifications: Installer is to be experienced in applying air barrier materials similar in material, design, and extent to those indicated for this Project, whose work has resulted in applications with a record of successful performance.
- B. Blower-Door Testing: Identify location of Air Barrier material throughout the unit to be sealed. Test all units for leakage to outside before beginning any air sealing strategy. Pressurize to 50 Pa and record leakage, or extrapolate to leakage at CFM50. After completing air sealing tasks, provide follow-up blower door test to assure that owner's reduction requirement has been met.
- C. Pre Installation Conferences: Review air sealing requirements including surface preparation, substrates, curing/drying periods, installation procedures, repairs and protection. Coordinate air sealing strategies and sequencing with HVAC contractor to ensure that no work is duplicated or neglected.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Store materials in their original undamaged packages in a clean, dry, protected location and within temperature range required by product manufacturer.
- B. Remove and replace liquid materials that cannot be applied within their stated shelf life. Protect stored materials from sunlight.

1.8 PROJECT CONDITIONS

- A. Environmental Limitations: Apply air sealing materials within the range of ambient temperatures recommended by the product manufacturer.

PRODUCTS

1.9 RIGID AIR BARRIER MATERIALS

- A. Gypsum Wall Board (GWB)
- B. Oriented Strand Board (OSB)
- C. Rigid Faced Insulation Board

1.10 POLYURETHANE SPRAY FOAM

- A. Single-part Spray Foam (Expanding and non-expanding)
- B. Two-part Spray Foam

1.11 CAULKS AND JOINT SEALANTS

- A. Silicone or polyurethane caulk
- B. Latex, expanding foam

1.12 FLUID APPLIED AIR BARRIERS

- A. Liquid Air Barrier Membranes and Mastics

1.13 AUXILIARY MATERIALS

- A. General: Employ auxiliary materials recommended by manufacturer for intended use and compatible with substrates and membranes.
- B. Transition reinforcing strips: Glass fiber mesh tapes approved by Air Barrier Manufacturer at voids with spans greater than ¼”.
- C. Backer Rod: Compressible foam backer rod to be installed before applying sealants and mastics at areas with cracks larger than ¼”.
- D. Mechanical Fasteners: Provide wood or gypsum board screws as needed of length necessary to securely fasten rigid air barrier materials to structure.
- E. Weatherstripping: Provide flexible weatherstripping around doors and attic accesses to reduce air infiltration

EXECUTION

1.14 EXAMINATION

- A. Examine substrates areas and conditions, with installer present, for compliance with requirements and other conditions affecting performance.
 - 1. Verify that substrates are sound and free of oil, grease, dirt, excess mortar and other contaminants.

1.15 SURFACE PREPARATION

- A. Provide clean, dust-free, and dry substrate for air barrier application.
- B. Mask off adjoining surfaces to be covered by air barrier to prevent spillage and overspray in the visible living area.
- C. At changes in substrate plane, apply sealant or mastic at sharp corners and edges to form a smooth transition from one place to another
- D. Where rigid materials are to be fastened, provide clean adjacent edges to create a flush or near flush (within ¼") transition between existing and new rigid materials. Cut away jagged edges to create a regular surface before inserting patches. Ensure that structural base for rigid air barrier material will adequately support the material to be fastened. Cut patches to dimensions to minimize unnecessary use of backer rod, tapes, and strips.

1.16 PRIORITY

- A. General: Air Sealing tasks are to be prioritized to maximize results over time. Seal largest areas of compromised air barrier first, and then work toward locations with smaller air leaks.
- B. Primary Areas
 - 1. Missing Sheathing: Install/repair air barrier above dropped ceilings in kitchens. Provide and install rigid air barriers and sealing products to complete airtight assembly above dropped ceiling. Prepare surfaces to receive rigid air barrier panels, patches, and plugs. Mechanically fasten OSB or GWB to structure and seal all joints and intersections with joint sealants or fluid applied membranes. Seal existing and newly installed rigid air barriers to make a complete air barrier.
 - 2. Plumbing, Electrical, Mechanical penetrations: Seal and make airtight all penetrations through the air barrier, including (not limited to): Plumbing penetrations around pipes, drains and vents; Mechanical penetrations around supply ducts, returns, and exhaust fans; Electrical penetrations surrounding outlets, conduits and wiring. For air leaks around penetrations which are greater than ¼", rigid plugs or mesh transition reinforcement strips should be used to bridge gaps and allow for full sealing of penetrations.
 - 3. HVAC Closets: Completely seal perimeter and voids in HVAC closets with caulk to ensure that no air leaks between outside and mechanically depressurized closets.

4. Other voids: Air seal all other voids present in vertical and horizontal air barrier assemblies using appropriate products to complete an air tight boundary.
- C. Secondary Leakage Areas
1. Attic access: Provide and install perimeter weatherstripping to reduce air infiltration around attic hatch.
 2. Ceiling-to-wall and floor-to-wall: Provide and install air sealing materials to create an airtight boundary between the floor and ceiling surfaces and the vertical walls.
 3. Exterior Doors: Provide and install flexible weatherstripping to ensure a tight seal around all exterior doors. Ensure that exterior doors fit snugly in their openings and adjust placement to maintain air tightness on all sides.
 4. Windows: Apply sealants and necessary backers to ensure that window installation forms a tight air barrier. Be sure that sealant connects window to wall air barrier. Windows generally have a primary exterior weather barrier that often does not serve as an air barrier
Electrical Fixtures: Apply sealant to all fixtures which penetrate the air barrier, or completely remove fixture and repair air barrier.


1.17 FIELD QUALITY CONTROL

- A. Testing Agency: Owner may engage a qualified testing agency to perform random inspections and air leakage testing, and prepare reports detailing the findings.
- B. Inspection: Installation and products are subject to inspection for compliance with the owner's and manufacturer's requirements. Inspections may include:
 1. Continuity of repairs has been achieved with no voids, gaps, or holes unsealed.
 2. Laps in transitions have been layered in the correct direction, or mastic has been applied to exposed edges.
 3. Sealants and strips have been firmly adhered or fastened to the substrate material
 4. Compatibility of materials.
 5. All penetrations have been sealed.
- C. Testing: Provide evidence of reduced air leakage using blower door testing and smoke visualization inspection.
- D. Remove and replace deficient air sealing components and retest.

1.18 CLEANING AND PROTECTION

- A. Clean spills, stains, and soiling from construction that would be exposed in the completed work using cleaning agents and procedures recommended by the manufacturer of the affected construction.
- B. Remove masking materials after installation.

Appendix B: Air Sealing Instructions

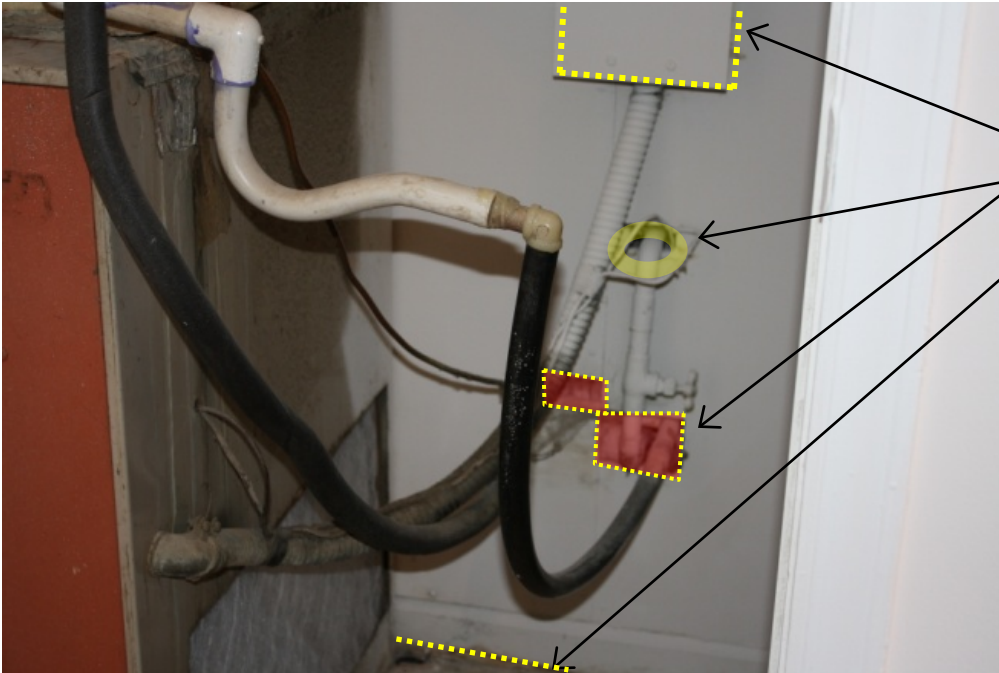


Typical electrical and mechanical piping penetration in HVAC return closet

1. Seal electrical boxes to wallboard with foam or caulk.
2. Make piping penetrations airtight, using sealants, foam, and plugs.
3. Seal all transitions in HVAC return closet between floor and wall and ceiling and wall



Typical electrical fixture penetration

1. Seal can lights and ceiling fan to air barrier or remove completely and repair air barrier. Seal entire perimeter of fan. Air leakage within the fixture assemblies might require installing airtight enclosures on the attic side, and then sealing them to the ceiling air barrier with foam, caulk, or gaskets depending on air barrier and enclosure material.
2. Seal intersection of HVAC supply duct with ceiling air barrier.

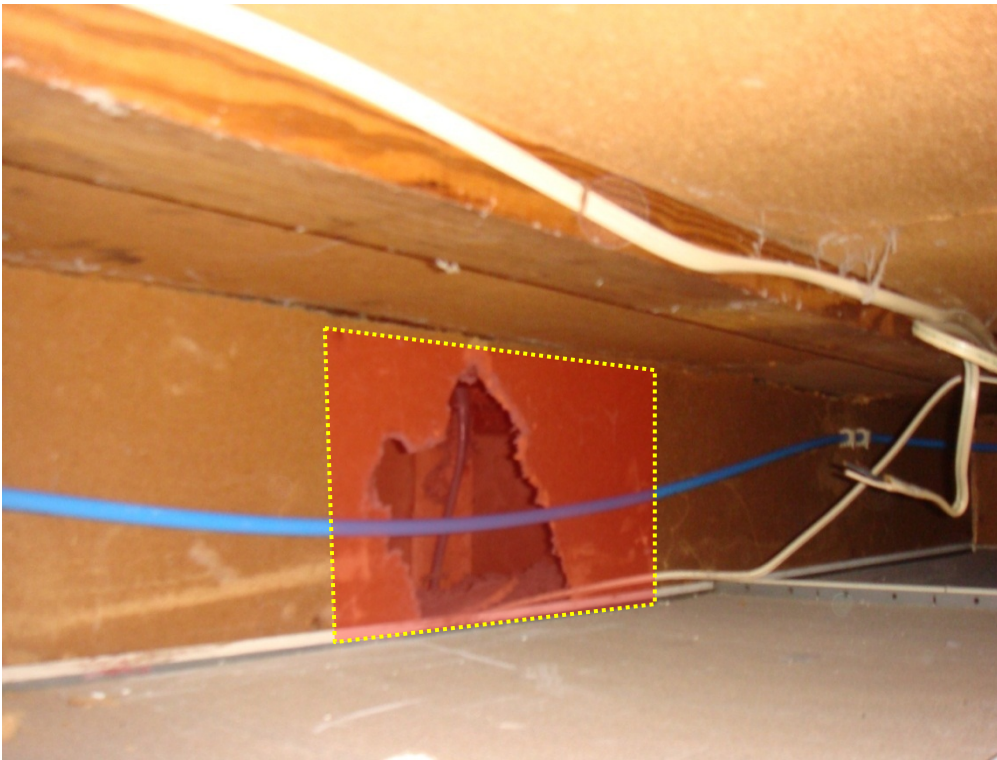


Typical void above kitchen area dropped ceiling

Install patch or plug and mechanically fasten to substrate, then make airtight with sealant or fluid-applied membrane around perimeter.




Typical access void behind tub in bathroom

Install patch or plug and mechanically fasten to substrate, then make airtight with sealant or fluid-applied membrane around perimeter.

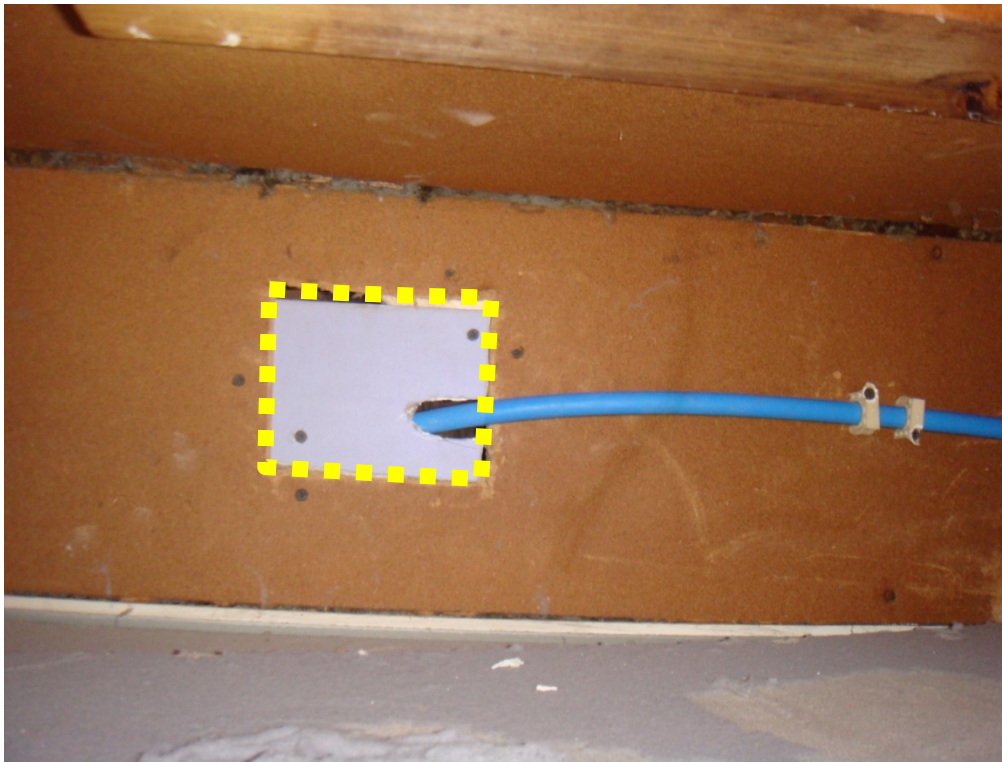


Incomplete air sealing patch

The hole has been prepared and a plug inserted and mechanically fastened. Sealant requirements have not been met. Use spray foam, caulk, or fluid-applied membrane to make penetrations airtight.

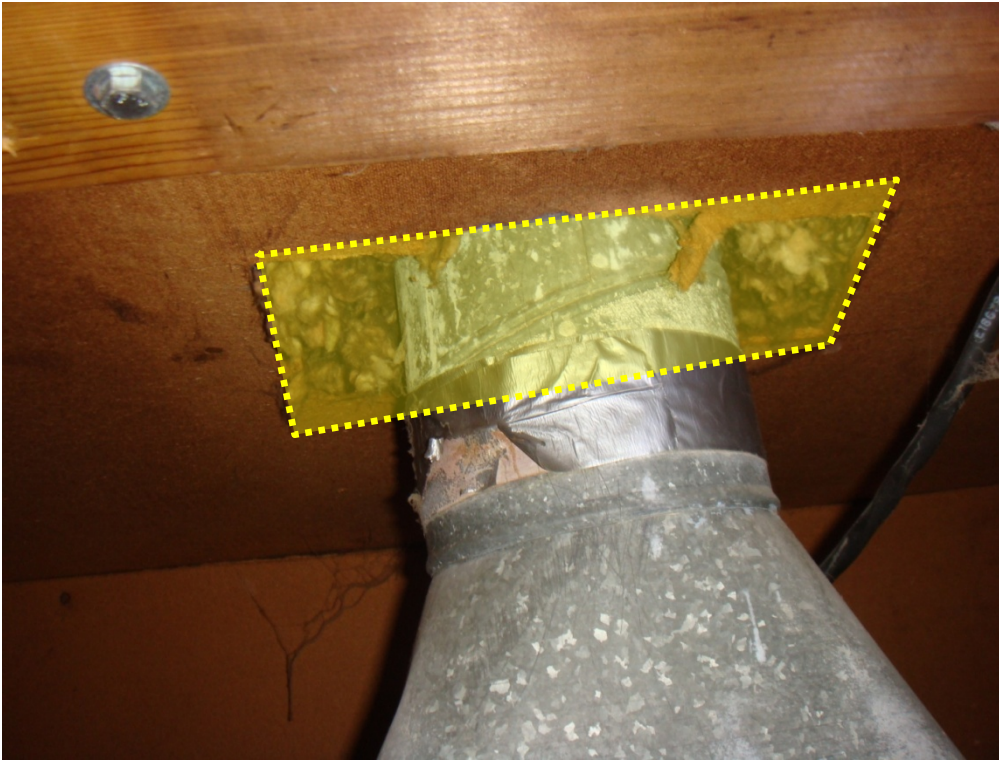


Typical unsealed duct penetration

Apply spray foam or sealant/membrane with transition strips around HVAC penetration to make airtight.

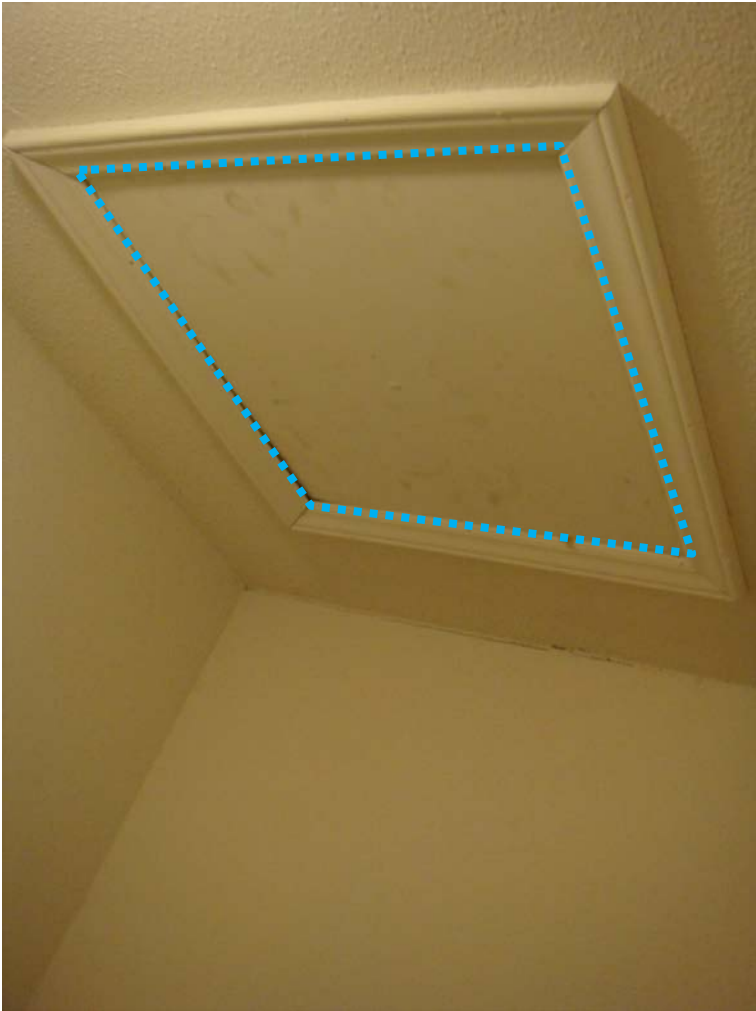

Typical attic scuttle


Install weather stripping to create snug seal between ceiling and attic scuttle.

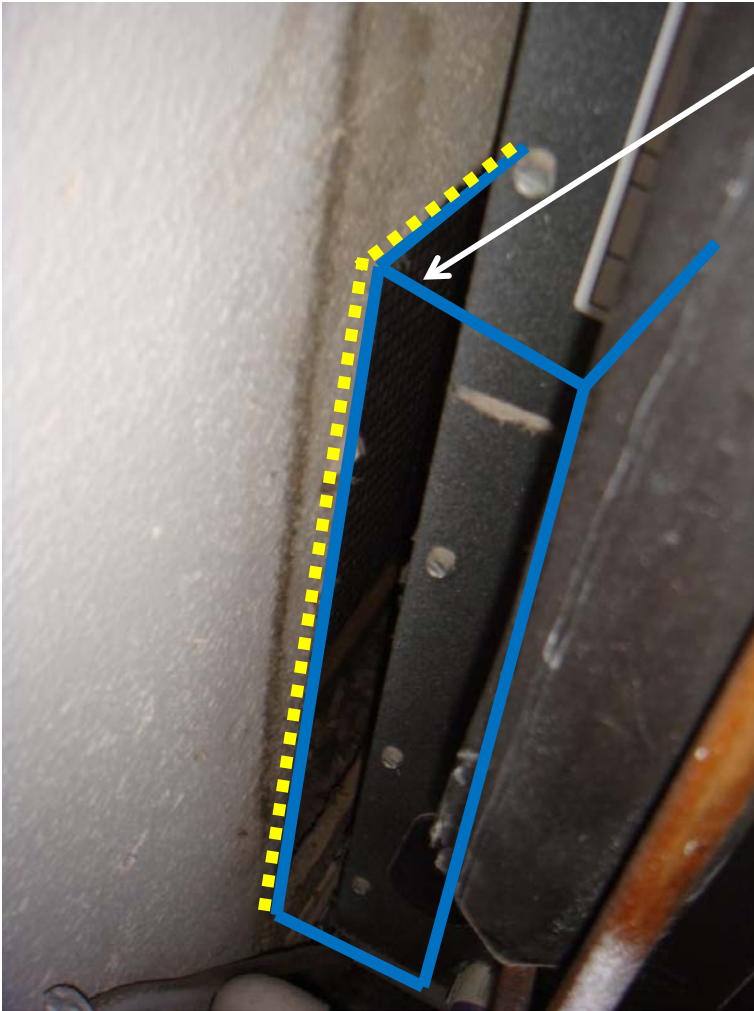

Unsealed HVAC return

Install return duct between air handler and grill (HVAC scope).

Make airtight with sealant or membrane.

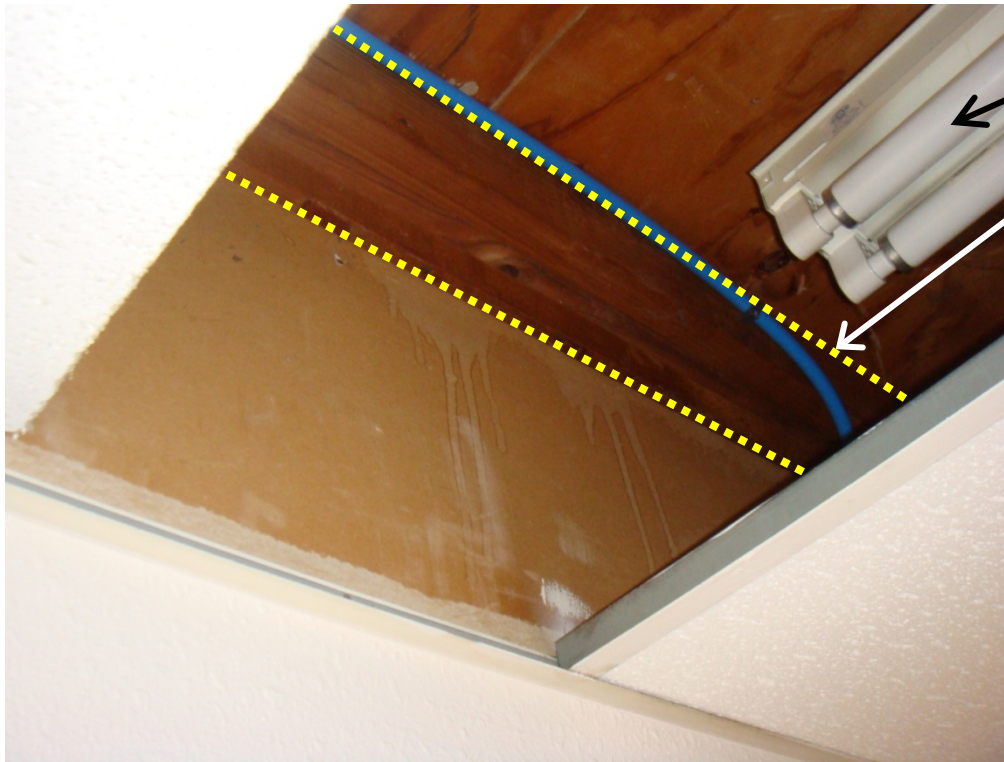

Typical kitchen area above dropped ceiling


Seal attic penetrations for light fixture above dropped ceiling, or remove fixture entirely and repair air barrier.

Seal drywall and ceiling lid to structure with a continuous bead of caulk or joint sealant.



HVAC duct penetration through air barrier

Install sealants or membranes with backer rod or transition strips as necessary to make duct penetration airtight.

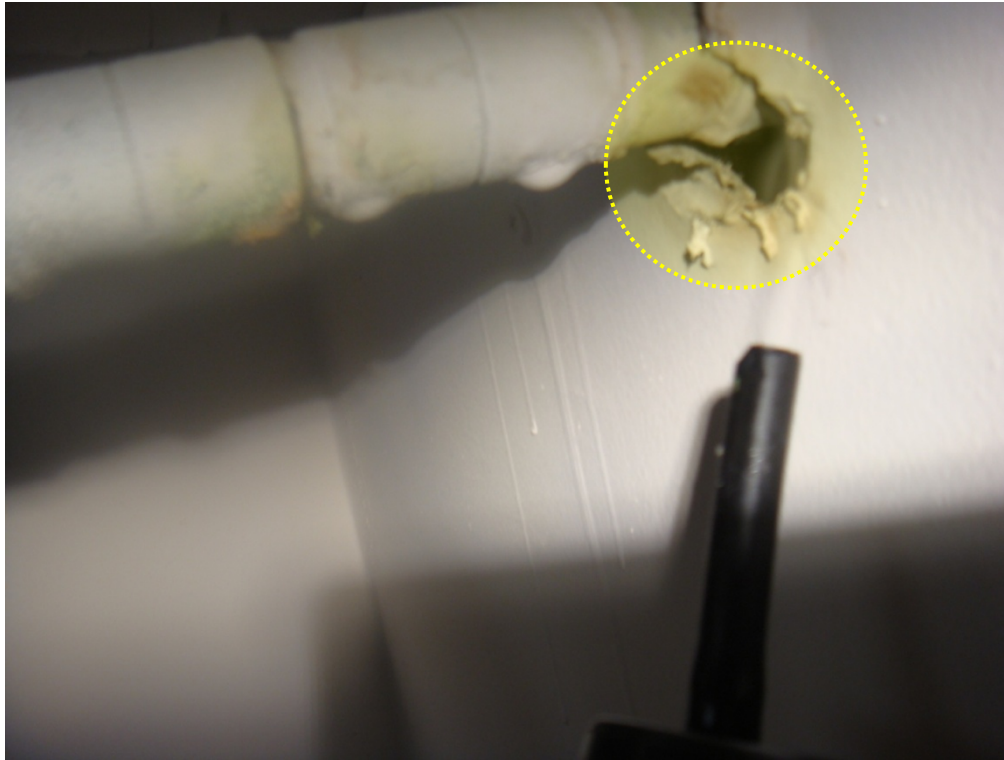

Typical unsealed plumbing penetration under sink

Air seal between the plumbing penetration and the
GWB air barrier using continuous beads of spray
foams or fluid membrane with transition strips.



Floor to wall transition

Pull carpeting away from wall. Clean area to ensure sealant adhesion and install a continuous bead of sealant to make floor-to-wall intersection airtight. Use backer rod to support sealant at openings greater than $\frac{1}{4}$ in., or the distance described in the sealant manufacturer's installation instructions.



Typical bathroom electrical fixture penetration

Make fixture airtight by installing an airtight enclosure on the inside-wall side of the air barrier and sealing the enclosure to the inside-wall side of the air barrier. Alternatively, remove the fixture, install “Air Barrier Rated” lighting fixture, and caulk rated fixture to GWB air barrier to ensure airtight seal.

Appendix C: Unguarded Envelope Testing Results

Building	Unit	CFA (ft ²)	Pre-Retrofit Leakage (cfm ₅₀)	Post-Retrofit Leakage (cfm ₅₀)	Pre-Retrofit Leakage (cfm ₅₀ /CFA)	Post-Retrofit Leakage (cfm ₅₀ /CFA)	Pre-Retrofit Leakage (ACH ₅₀)	Post-Retrofit Leakage (ACH ₅₀)	Change (%)
1700	2	1,500	3,295	1,644	2.20	1.10	16.5	8.2	-50
1700	7	1,500	7,023	2,078	4.68	1.39	35.1	10.4	-70
1700	9	1,500	2,330	1,512	1.55	1.01	11.7	7.6	-35
1700	12	1,500	2,634	2,042	1.76	1.36	13.2	10.2	-22
1700	14	1,500	4,035	1,993	2.69	1.33	20.2	10.0	-51
1700	15	1,500	3,420	1,693	2.28	1.13	17.1	8.5	-50
1800	2	1,500	3,166	1,632	2.11	1.09	15.8	8.2	-48
1800	4	1,500	3,499	2,189	2.33	1.46	17.5	10.9	-37
1800	9	1,500	3,913	1,993	2.61	1.33	19.6	10.0	-49
1800	10	1,500	3,399	1,926	2.27	1.28	17.0	9.6	-43
1800	11	1,500	3,637	1,746	2.42	1.16	18.2	8.7	-52
1800	12	1,500	3,030	1,560	2.02	1.04	15.2	7.8	-49
1800	14	1,500	4,000	1,715	2.67	1.14	20.0	8.6	-57
1800	16	1,500	2,905	1,864	1.94	1.24	14.5	9.3	-36
1800	17	1,500	2,474	1,324	1.65	0.88	12.4	6.6	-46
1800	18	1,500	2,934	1,412	1.96	0.94	14.7	7.1	-52
1800	19	1,500	2,900	1,419	1.93	0.95	14.5	7.1	-51
1800	21	1,500	6,516	1,928	4.34	1.29	32.6	9.6	-70
1800	22	1,500	3,684	1,778	2.46	1.19	18.4	8.9	-52
1920	14	1,200	3,956	1,865	3.30	1.55	24.7	11.7	-53
1920	15	1,200	4,119	2,171	3.43	1.81	25.7	13.6	-47
1920	19	1,200	3,039	2,039	2.53	1.70	19.0	12.7	-33
2011	1	1,500	2,661	1,611	1.77	1.07	13.3	8.1	-39
2029	8	1,500	3,462	1,720	2.31	1.15	17.3	8.6	-50
2030	4	1,500	3,834	1,965	2.56	1.31	19.2	9.8	-49
2030	5	1,500	3,176	1,687	2.12	1.12	15.9	8.4	-47
2030	10	2,200	5,035	1,727	2.29	0.79	17.2	5.9	-66
2117	2	1,200	2,233	1,648	1.86	1.37	14.0	10.3	-26
2117	23	2,000	4,210	2,106	2.11	1.05	15.8	7.9	-50
2132	4	1,200	3,634	1,756	3.03	1.46	22.7	11.0	-52
2132	10	1,500	2,438	1,263	1.63	0.84	12.2	6.3	-48
2132	15	1,200	4,218	2,172	3.52	1.81	26.4	13.6	-49
2132	22	1,200	3,023	1,643	2.52	1.37	18.9	10.3	-46
2132	23	1,200	2,627	1,345	2.19	1.12	16.4	8.4	-49
2219	1	1,500	4,950	2,032	3.30	1.35	24.8	10.2	-59

2219	5	1,500	3,709	1,907	2.47	1.27	18.5	9.5	-49
2235	2	1,200	5,671	2,408	4.73	2.01	35.4	15.1	-58
2235	4	1,200	3,846	1,748	3.21	1.46	24.0	10.9	-55
2247	2	1,200	3,664	1,618	3.05	1.35	22.9	10.1	-56
2247	5	1,200	2,345	1,461	1.95	1.22	14.7	9.1	-38
2309	3	1,200	3,927	1,817	3.27	1.51	24.5	11.4	-54
2309	7	1,200	4,076	1,667	3.40	1.39	25.5	10.4	-59
2309	16	1,500	3,727	1,679	2.48	1.12	18.6	8.4	-55
2309	17	1,500	2,737	1,718	1.82	1.15	13.7	8.6	-37
2309	20	1,200	5,586	1,250	4.66	1.04	34.9	7.8	-78
2309	25	1,200	6,646	1,742	5.54	1.45	41.5	10.9	-74
2314	4	1,500	2,932	1,972	1.95	1.31	14.7	9.9	-33
2330	4	1,500	3,834	1,965	2.56	1.31	19.2	9.8	-49
2330	9	1,500	4,094	1,641	2.73	1.09	20.5	8.2	-60
2330	15	1,500	4,218	2,172	2.81	1.45	21.1	10.9	-49
2330	21	2,000	3,541	1,876	1.77	0.94	13.3	7.0	-47
Average					2.64	1.26	19.8	9.4	-50
Median					2.46	1.27	18.4	9.5	-49
Standard deviation					0.89	0.25	6.7	1.9	11

Appendix D: Pressure Mapping Data

Building, Unit	Test Pressure (Pa)	Location	Pressure Reading (Pa)	Pressure Difference (Pa)	% Inside
2117, Apartment 2	50	Common wall	45	5	10
		Kitchen soffit	44	6	12
		Common wall under stair	40	10	20
		Exterior wall	46	4	9
		Attic	51	-1	-2
2309, Apartment 16	40	Exterior wall	23	17	41
		Common wall	20	20	51
		Dropped ceiling	20	20	50
		Exterior wall	16	24	61
		Exterior wall	26	14	36
		Interior wall	29	11	29
2117, Apartment 3	40	Common wall	33	7	18
		Common wall	27	13	33
		Kitchen chase	22	18	45
		Ceiling bet floors	28	12	30
		Dropped ceiling	39	1	3
		Crawl	22	18	45
		Attic	29	11	28
		Supply duct	28	12	30
		Return duct	25	15	38
2030, Apartment 8	22	Supply duct	29	11	28
		Attic	22	0	0
		Supply duct	16	6	27
		Dropped ceiling	16	6	27
		Common wall	18	4	18
		Attic	4	18	82
		Interior wall	7	15	68
		Exterior wall	9	13	59
Exterior wall	16	6	27		

buildingamerica.gov

U.S. DEPARTMENT OF
ENERGY | Energy Efficiency &
Renewable Energy

DOE/GO-102012-3583 • October 2012

Printed with a renewable-source ink on paper containing at least 50% wastepaper, including 10% post-consumer waste.